

Figure 1

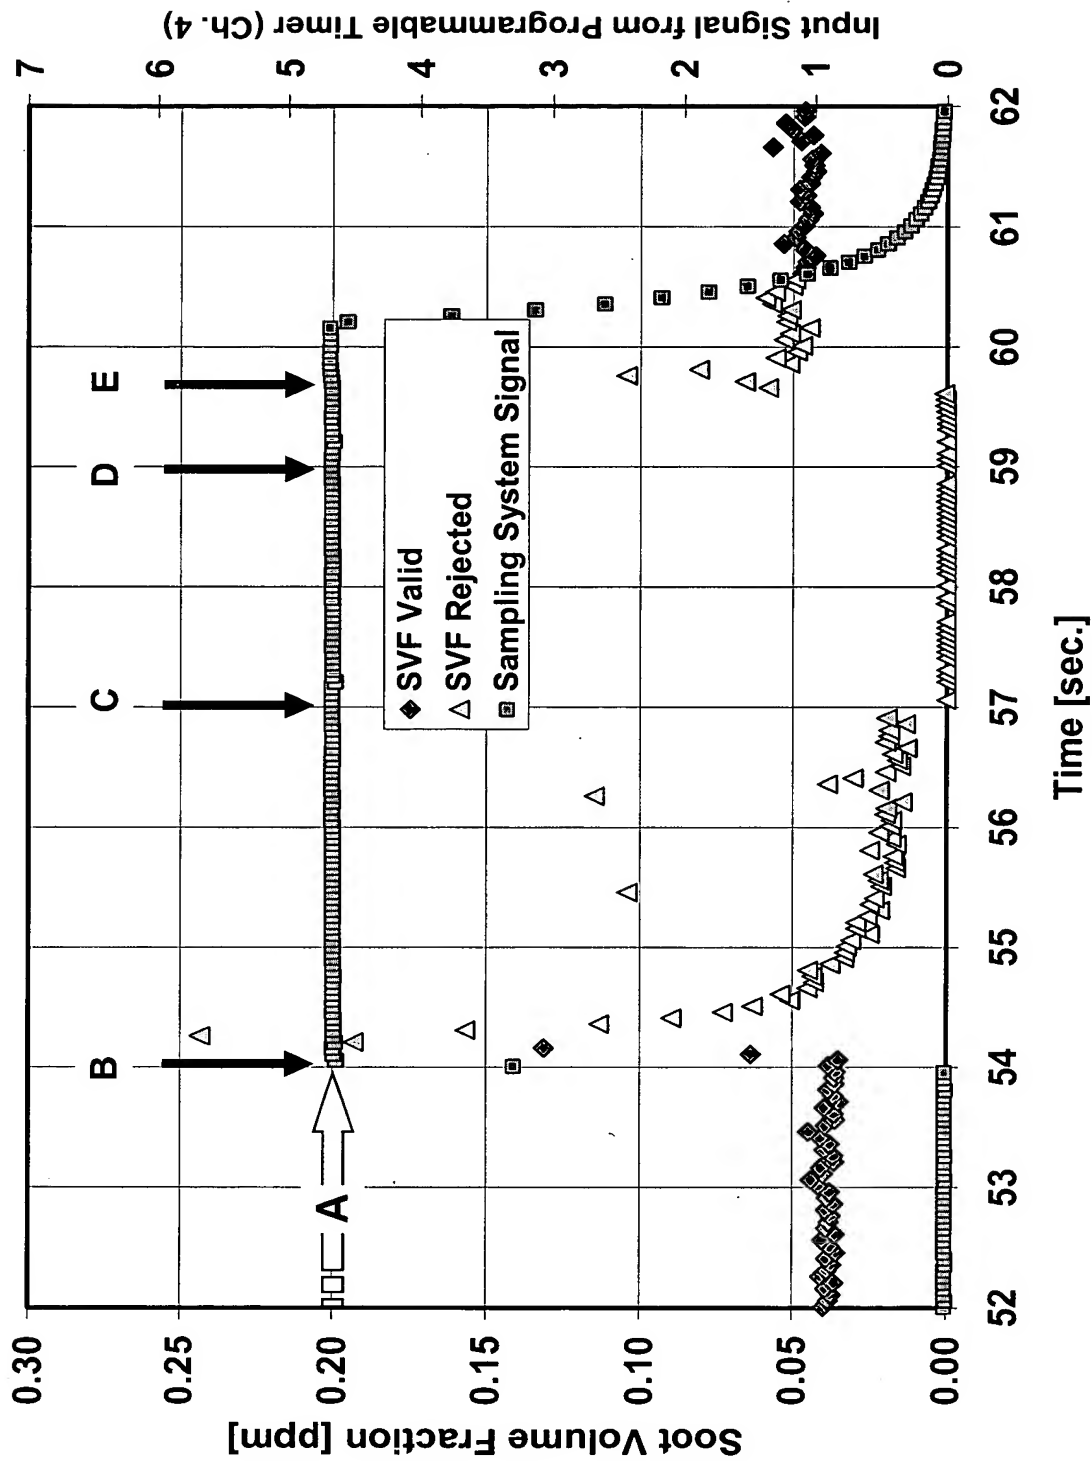


Figure 2

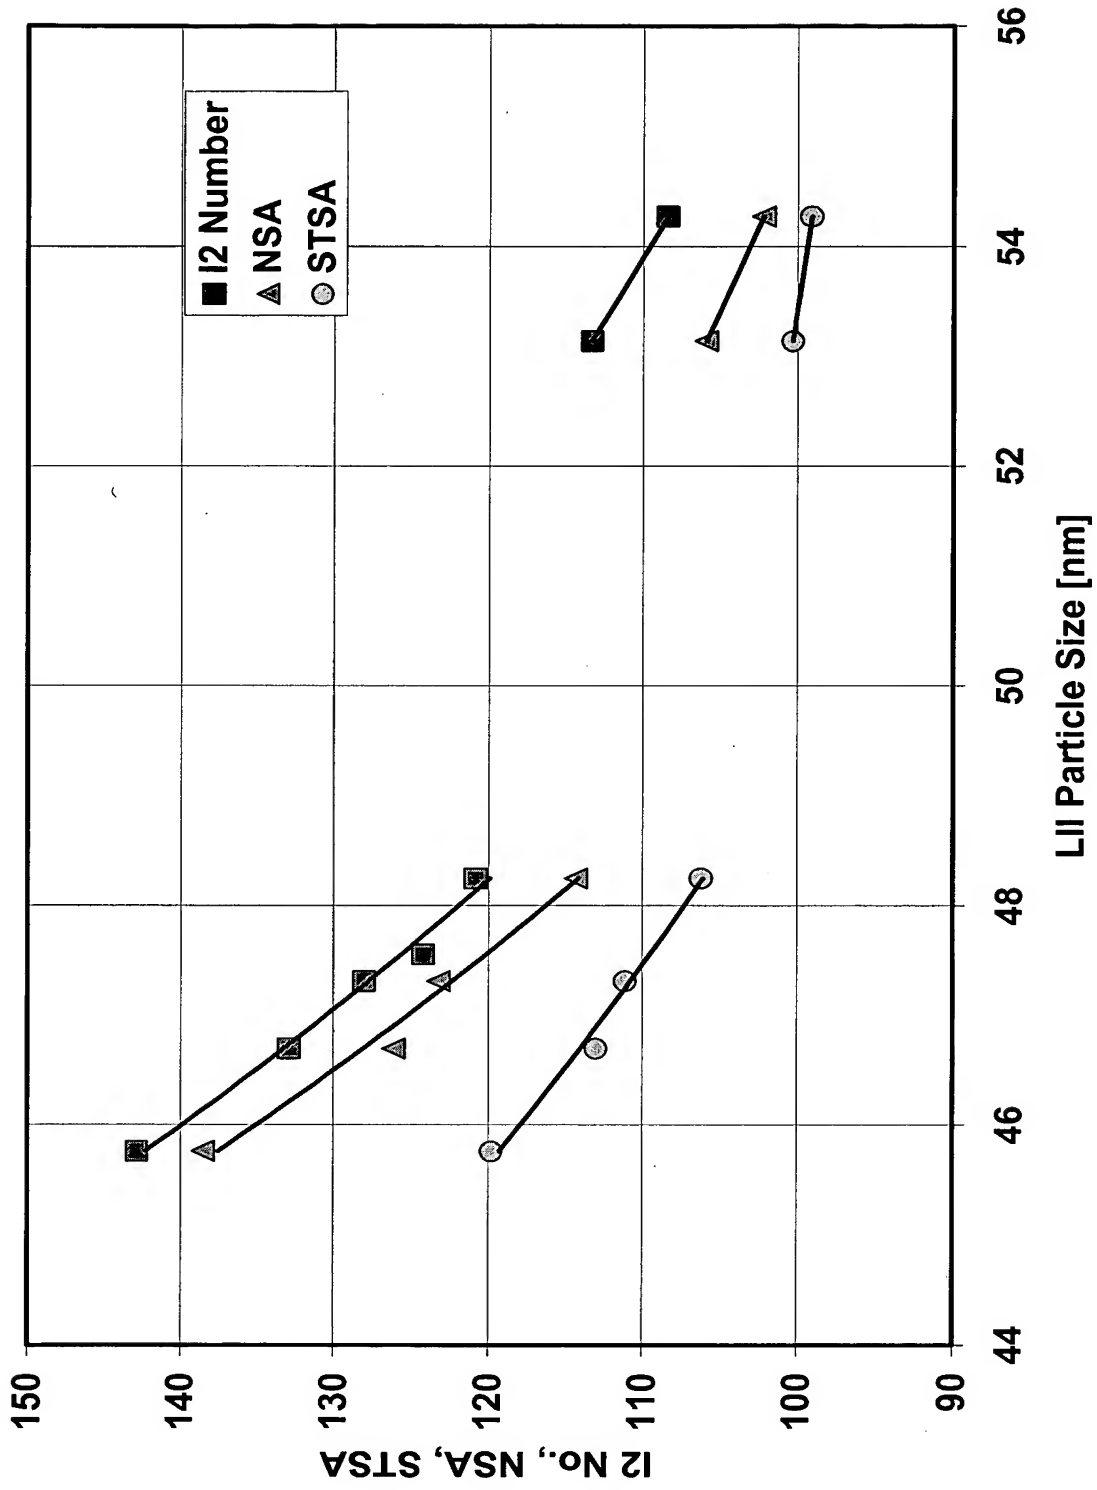


Figure 3

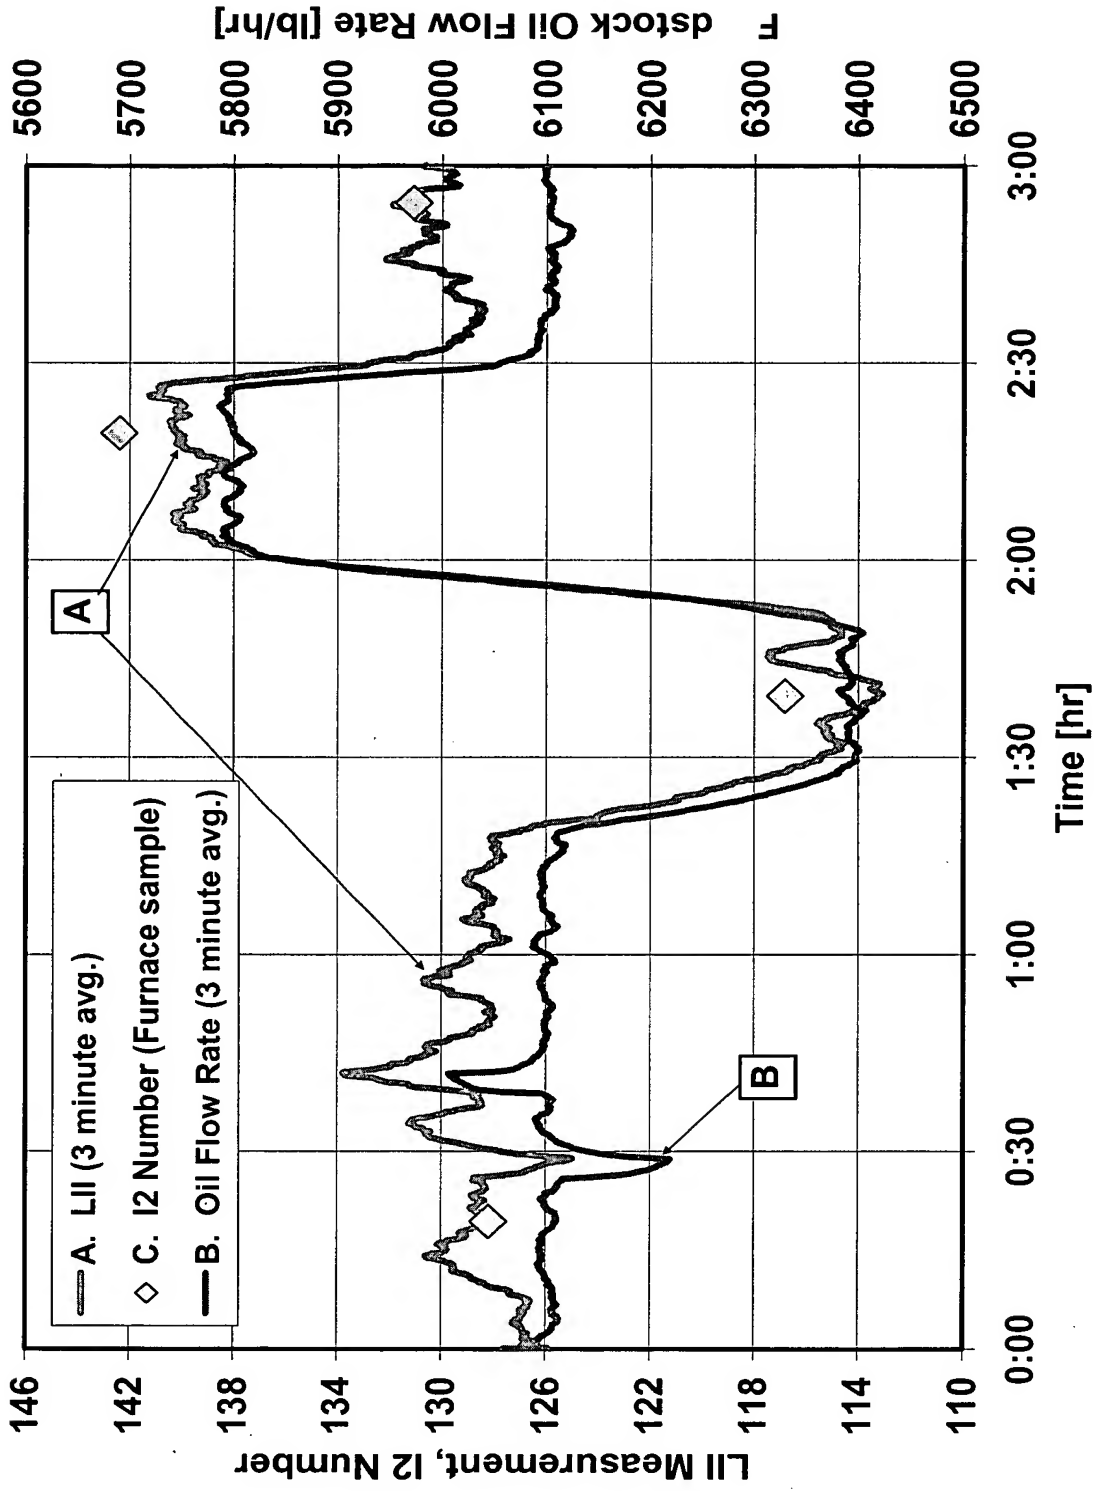


Figure 4

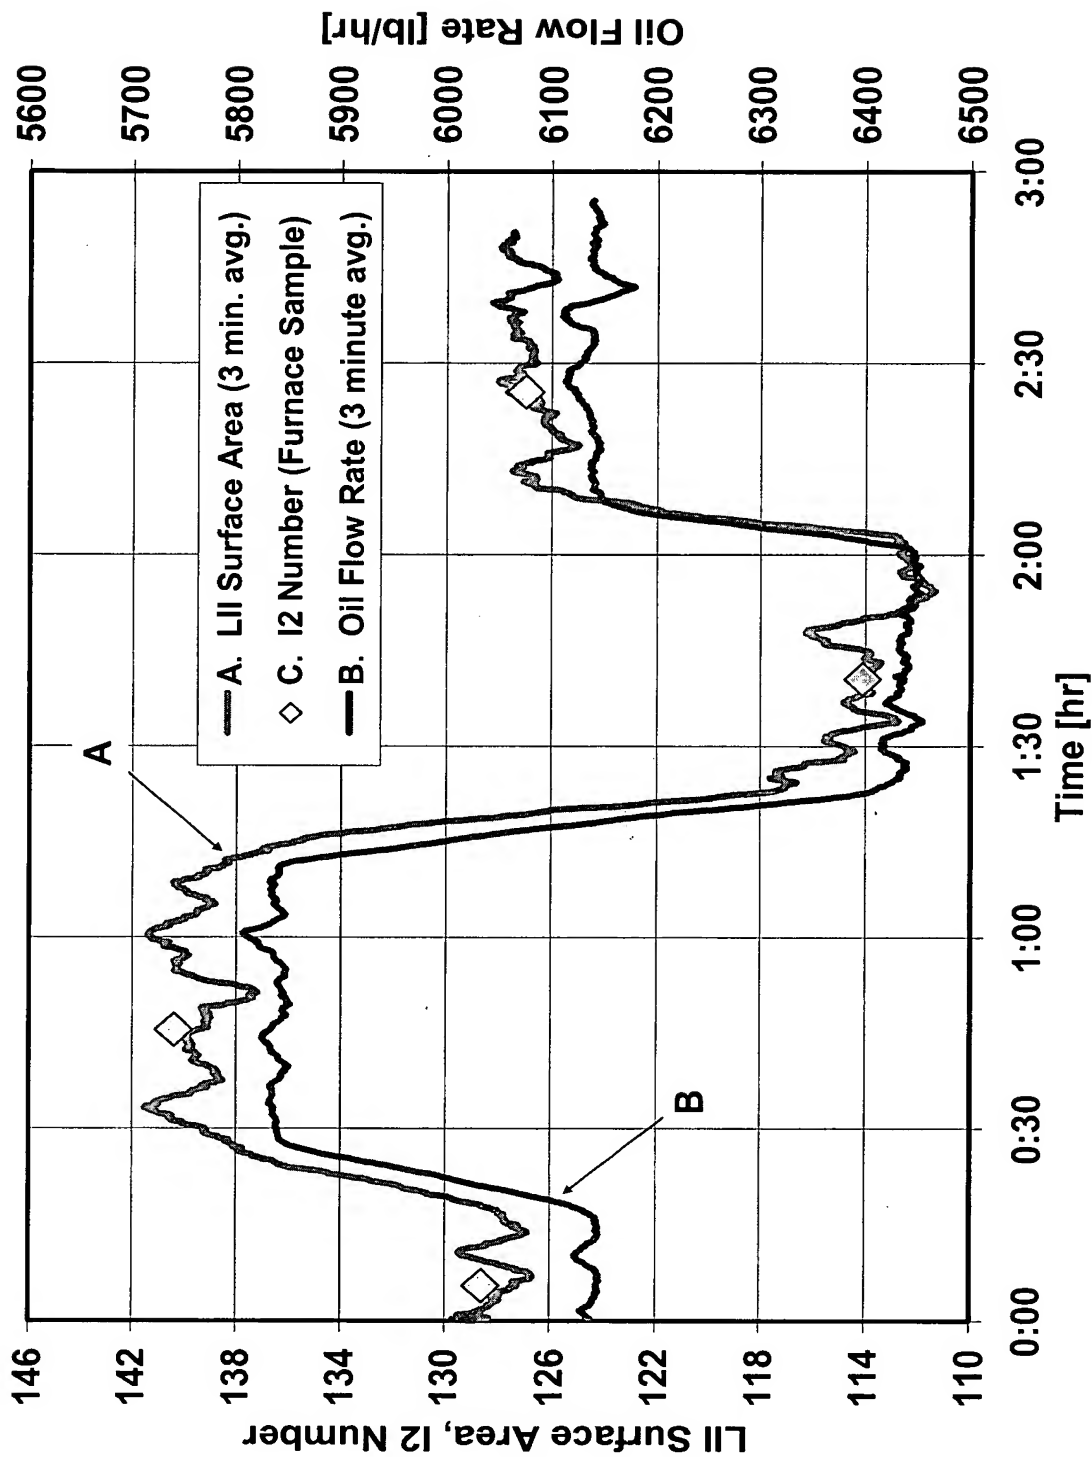


Figure 5

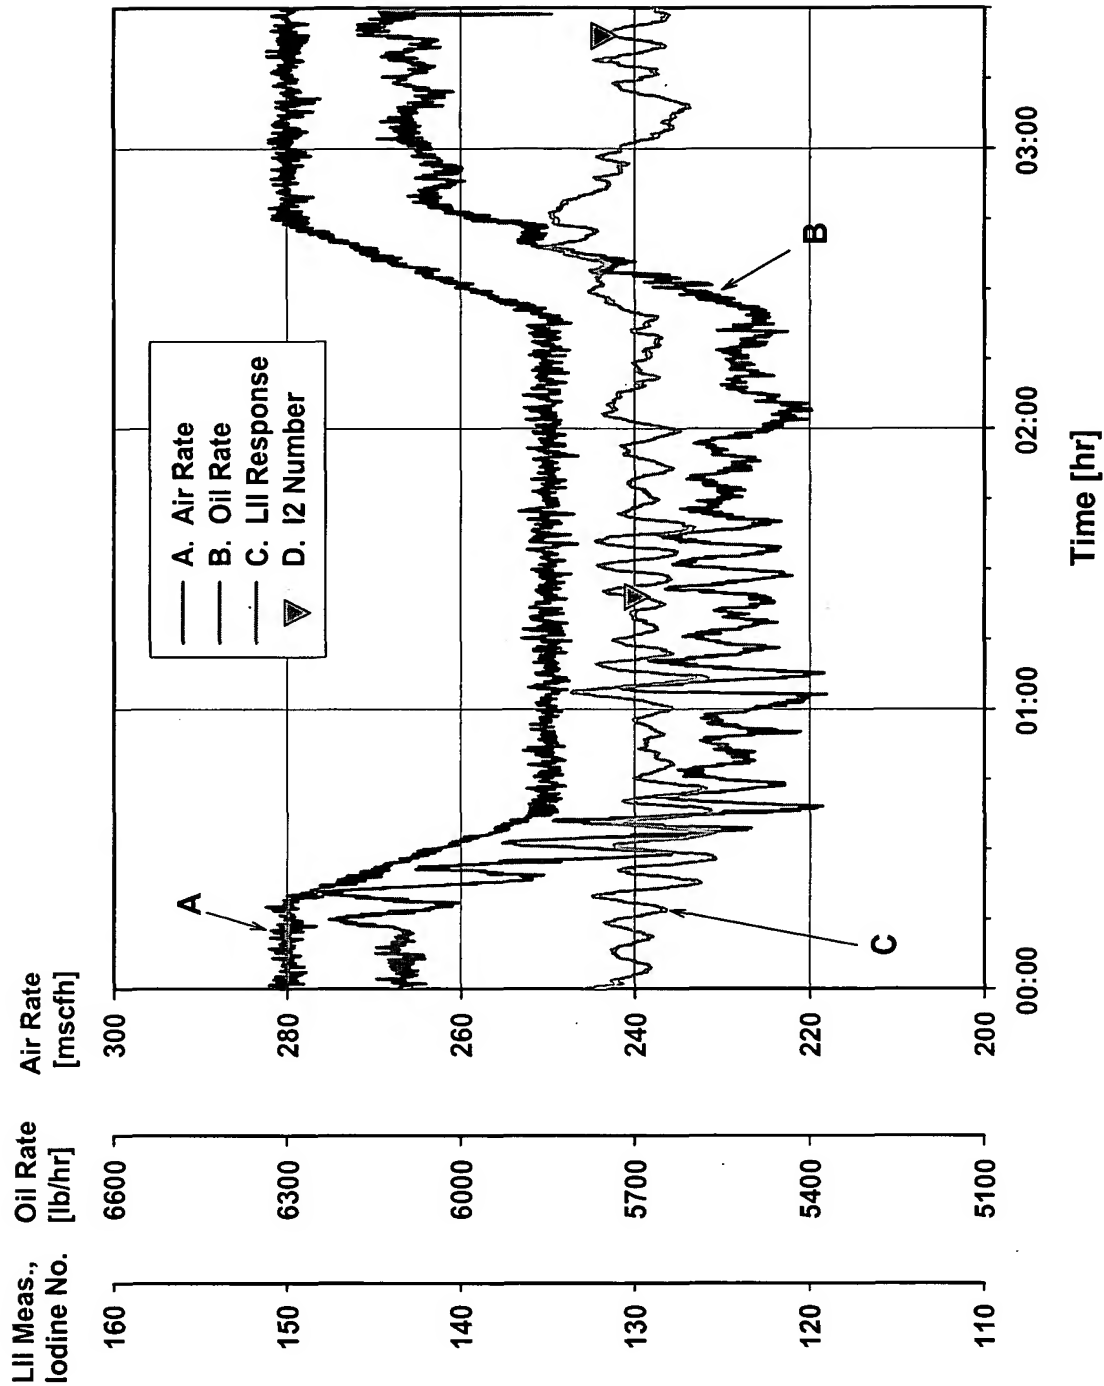


Figure 6


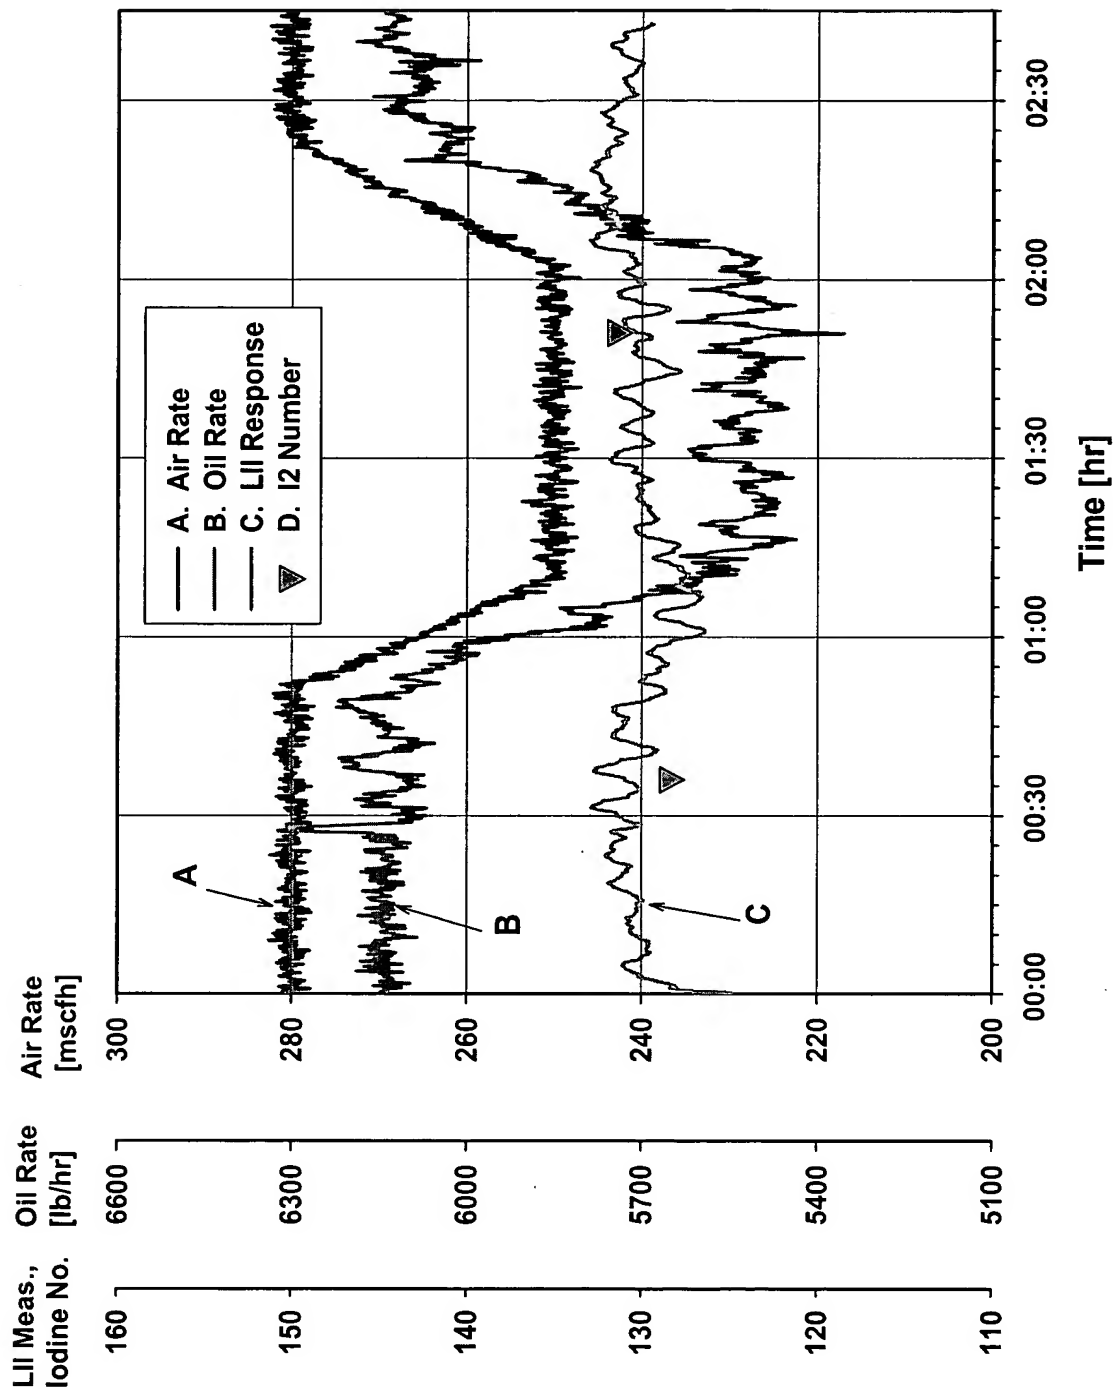


Figure 7

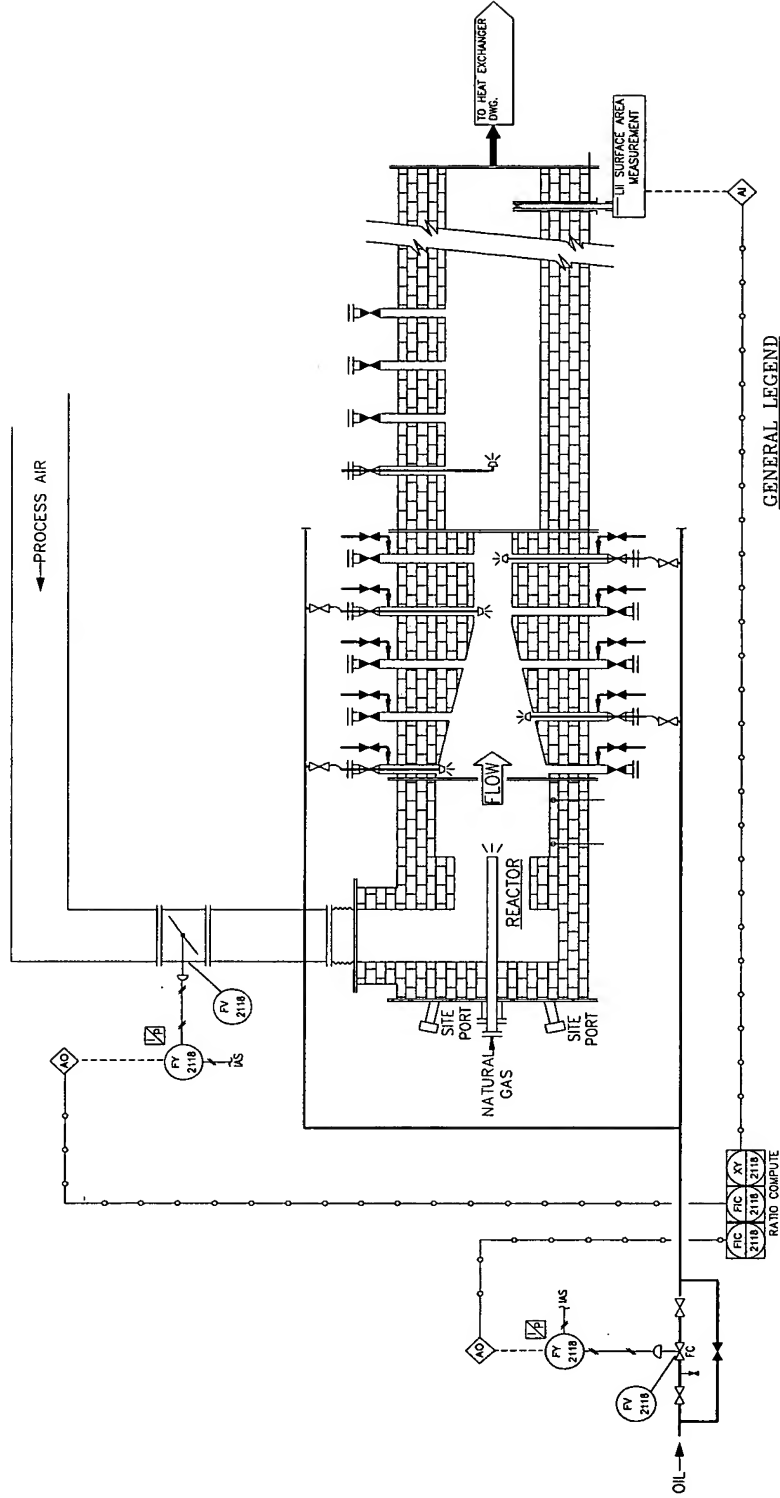

FV - AIR OPERATED FLOW CONTROL VALVE (BUTTERFLY / BALL VALVE OR DAMPER SYSTEM)  
 FY - CURRENT TO PNEUMATIC CONVERTER  
 FIC - FLOW INDICATING CONTROLLER (SINGLE LOOP OR MOORE APACS DCS)  
 AO - 24 VDC ANALOG OUTPUT  
 AI - 24 VDC ANALOG INPUT  
 XY - SOFTWARE RATIO CONTROLLER  
 IAS - INSTRUMENT AIR SIGNAL

FIGURE 8